

# Kitemark™ Certificate

This is to certify that:

Kentec Electronics Limited  
Unit 25-27 Dartford Trade Park  
Fawkes Avenue  
Questor  
Dartford  
DA1 1JQ  
United Kingdom

Holds Certificate Number:

KM 96761

In respect of:

**BS EN 54-2, BS EN 54-4 & BS EN 12094-1  
Control and Indicating Equipment and Power Supply Equipment, Electrical Automatic Control and  
Delay Devices for Gas Extinguishing Systems**

This issues the right and licence to use the Kitemark in accordance with the Kitemark Terms and Conditions governing the use of the Kitemark, as may be updated from time to time by BSI Assurance UK Ltd (the "Conditions"). All defined terms in this Certificate shall have the same meaning as in the Conditions.

The use of the Kitemark is authorized in respect of the Product(s) detailed on this Certificate provided at or from the above address.

For and on behalf of BSI:

Gary Fenton, Global Product Certification Director

First Issued: 19/10/2005

Latest Issue: 15/12/2015



# Kitemark™ Certificate

No. KM 96761

**BS EN 12094-1:2003, BS EN 54-2:1997 and BS EN 54-4:1998 + A1.**

## **Sigma XT series**

<b>Model Reference</b>	<b>Type</b>
K11031M2	Class A, Single area Fire Extinguishing Control Panel Surface mounting
K11031F2	Class A, Single area Fire Extinguishing Control Panel Flush mounting

Certified for use with Apollo, Fulleon, Hochiki, Nittan, Notifier and MorleyIAS System Sensor and KAC fire Detection and alarm products and MTL7778ac and MTL5561 intrinsically safe barriers.

The Sigma XT is certified when fitted with Swedish Keyswitch.

The Sigma XT is also suitable for use with the following units:

<b>Model Reference</b>	<b>Type</b>
K911000M8	6 lamp status unit surface
K911000F8	6 lamp status unit flush
K911100M8	6 lamp status unit with mode select keyswitch surface
K911100F8	6 lamp status unit with mode select keyswitch flush
K911010M8	6 lamp status unit with manual release surface
K911010F8	6 lamp status unit with manual release flush
K911110M8	6 lamp status unit with mode select keyswitch and manual release surface
K911110F8	6 lamp status unit with mode select keyswitch and manual release flush
W911000W8	IP65 - 6 lamp status unit surface
W911100W8	IP65 - 6 lamp status unit surface with mode select keyswitch surface
W911110W8	IP65 - 6 lamp status unit with mode select keyswitch and manual release surface
K91000M10	Extinguishant hold off switch unit - green button
KB91000M10	Extinguishant hold off switch unit - red button

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 2 of 7

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Kitemark™ Certificate

No. KM 96761

## Options with requirements

Certified with the following options with requirements from BS EN 54-2:1997

Output to fire alarm devices (clause 7.8)  
Delays to outputs (clause 7.11)  
Test condition (clause 10)

Certified with the following options with requirements from BS EN 12094-1:2003

Delay of extinguishing signal (clause 4.17)  
Signal representing the flow of extinguishing agent (clause 4.18)  
Monitoring of the status of components (clause 4.19)  
Emergency hold device (clause 4.20)  
Control of flooding time (clause 4.21)  
Manual only mode (clause 4.23)  
Triggering signals to equipment within the system (clause 4.24)  
Triggering signals to equipment outside the system (clause 4.26)  
Activation of alarm devices with different signals (clause 4.30)



First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 3 of 7

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Kitemark™ Certificate

No. KM 96761

**BS EN 12094-1:2003, BS EN 54-2:1997 + A1:2006 and BS EN 54-4:1997 + A1:2003 & A2:2006.**

## **Sigma XT+ series**

<b>Model Reference</b>	<b>Type</b>
K21001M2	Class A, Single area extinguishing control unit
K21021M3	Class A, Two zone, single area extinguishing control panel
K21041M3	Class A, Four zone, single area extinguishing control panel
K21042M3	Class A, Four zone, two area extinguishing control panel
K21081M3	Class A, Eight zone, single area extinguishing control panel
K21082M3	Class A, Eight zone, two area extinguishing control panel
K21083M4	Class A, Eight zone, three area extinguishing control panel
K21084M4	Class A, Eight zone, four area extinguishing control panel

Certified for use with Apollo series 30, 60 & 65, Fulleon, Hochiki, Nittan, Notifier and MorleyIAS ECO1000, KAC fire detection and alarm products and MTL7778ac and MTL5561 intrinsically safe barriers.

The Sigma XT+ is certified when fitted with Swedish Keyswitch.

The Sigma XT+ is also suitable for use with the following units:

<b>Model Reference</b>	<b>Type</b>
K911000M8	6 lamp status unit surface
K911000F8	6 lamp status unit flush
K911100M8	6 lamp status unit with mode select keyswitch surface
K911100F8	6 lamp status unit with mode select keyswitch flush
K911010M8	6 lamp status unit with manual release surface
K911010F8	6 lamp status unit with manual release flush
K911110M8	6 lamp status unit with mode select keyswitch and manual release surface
K911110F8	6 lamp status unit with mode select keyswitch and manual release flush
W911000W8	IP65 - 6 lamp status unit surface
W911100W8	IP65 - 6 lamp status unit surface with mode select keyswitch surface

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 4 of 7

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Kitemark™ Certificate

No. KM 96761

<b>Model Reference</b>	<b>Type</b>
W911110W8	IP65 - 6 lamp status unit with mode select keyswitch and manual release surface
K91000M10	Extinguishant hold off switch unit - green button
KB91000M10	Extinguishant hold off switch unit - red button

## Options with requirements

Certified with the following options with requirements from BS EN 54-2:1997

Output to fire alarm devices (clause 7.8)  
Delays to outputs (clause 7.11)  
Test condition (clause 10)

Certified with the following options with requirements from BS EN 12094-1:2003

Delay of extinguishing signal (clause 4.17)  
Signal representing the flow of extinguishing agent (clause 4.18)  
Monitoring of the status of components (clause 4.19)  
Emergency hold device (clause 4.20)  
Control of flooding time (clause 4.21)  
Manual only mode (clause 4.23)  
Triggering signals to equipment outside the system (clause 4.26)  
Emergency abort device (clause 4.27)  
Activation of alarm devices with different signals (clause 4.30)

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 5 of 7

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Kitemark™ Certificate

No. KM 96761

**BS EN 12094-1:2003, BS EN 54-2:1997 + A1:2006 and BS EN 54-4:1997 + A1:2003 & A2:2006**

**Syncro XT+  
K31000 & K32000 Series**

<b>Model Reference</b>	<b>Type</b>
A31161M3	Class A, 1 loop, 1 Area Extinguishant Control Panel
A32161M3	Class A, 2 loop, 1 Area Extinguishant Control Panel
A31162M3	Class A, 1 loop, 2 Area Extinguishant Control Panel
A32162M3	Class A, 2 loop, 2 Area Extinguishant Control Panel
A31163M4	Class A, 1 loop, 3 Area Extinguishant Control Panel
A32163M4	Class A, 2 loop, 3 Area Extinguishant Control Panel
A31164M4	Class A, 1 loop, 4 Area Extinguishant Control Panel
A32164M4	Class A, 2 loop, 4 Area Extinguishant Control Panel
H31161M3	Class A, 1 loop, 1 Area Extinguishant Control Panel
H32161M3	Class A, 2 loop, 1 Area Extinguishant Control Panel
H31162M3	Class A, 1 loop, 2 Area Extinguishant Control Panel
H32162M3	Class A, 2 loop, 2 Area Extinguishant Control Panel
H31163M4	Class A, 1 loop, 3 Area Extinguishant Control Panel
H32163M4	Class A, 2 loop, 3 Area Extinguishant Control Panel
H31164M4	Class A, 1 loop, 4 Area Extinguishant Control Panel
H32164M4	Class A, 2 loop, 4 Area Extinguishant Control Panel
V31161M3	Class A, 1 loop, 1 Area Extinguishant Control Panel
V32161M3	2 loop, 1 Area Extinguishant Control Panel
V31162M3	Class A, 1 loop, 2 Area Extinguishant Control Panel
V32162M3	Class A, 2 loop, 2 Area Extinguishant Control Panel
V31163M4	Class A, 1 loop, 3 Area Extinguishant Control Panel

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 6 of 7

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Kitemark™ Certificate

No. KM 96761

<b>Model Reference</b>	<b>Type</b>
V32163M4	Class A, 2 loop, 3 Area Extinguishant Control Panel
V31164M4	Class A, 1 loop, 4 Area Extinguishant Control Panel
V32164M4	Class A, 2 loop, 4 Area Extinguishant Control Panel

Certified for use with Apollo, Hochiki, and Argus Vega fire detection and alarm products

Prefix A = Apollo Protocol, H = Hochiki Protocol & V = Argus Vega Protocol

The following Sigma Si status units are compatible for use with the K31000 & K32000 models in Table 1:

K911000M8 6 lamp status unit surface  
K911000F8 6 lamp status unit flush  
K911100M8 6 lamp status unit with mode select keyswitch surface  
K911100F8 6 lamp status unit with mode select keyswitch  
K911010M8 6 lamp status unit with manual release surface  
K911010F8 6 lamp status unit with manual release flush  
K911110M8 6 lamp status unit with mode select keyswitch and manual release surface  
K911110F8 6 lamp status unit with mode select keyswitch and manual release flush  
W911000W8 IP65 - 6 lamp status unit surface  
W911100W8 IP65 - 6 lamp status unit surface with mode select keyswitch surface  
W911110W8 IP65 - 6 lamp status unit with mode select keyswitch and manual release surface

## Options with requirements

Certified with the following options with requirements from BS EN 54-2:1997

Output to fire alarm devices (clause 7.8)  
Delays to outputs (clause 7.11)  
Test condition (clause 10)

Certified with the following options with requirements from BS EN 12094-1:2003

Delay of extinguishing signal (clause 4.17) – up to 60 seconds  
Signal representing the flow of extinguishing agent (clause 4.18)  
Monitoring of the status of components (clause 4.19)  
Emergency hold device (clause 4.20)  
Control of flooding time (clause 4.21)  
Manual only mode (clause 4.23)  
Triggering signals to equipment outside the system (clause 4.26)  
Emergency abort device (clause 4.27)  
Activation of alarm devices with different signals (clause 4.30)

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 7 of 7

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

This is to certify that:

Kentec Electronics Limited  
Unit 25-27 Dartford Trade Park  
Fawkes Avenue  
Questor  
Dartford  
DA1 1JQ  
United Kingdom

Holds Certificate Number:

0086-CPR-96748

In respect of:

**EN 12094-1:2003, EN 54-2:1997 + A1:2006 and EN 54-4:1997 + A1:2003 & A2:2006  
Electrical Automatic Control and Delay Devices  
Control and Indicating Equipment and Power Supply Equipment.**

In compliance with Regulation 305/2011/EU of the European Parliament and of the Council of 9 March 2011 (the Construction Products Regulation or CPR), this certificate applies to the above construction product. This certificate attests that all the provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the above standard(s) under system 1 are applied and that the product fulfils (products fulfil) all the prescribed requirements set out above. This certificate remains valid as long as the test methods and/or factory production control requirements included in the harmonised standard(s), used to assess the performance of the declared essential characteristics, do not change and the products(s), and the manufacturing conditions in the plants(s) are not modified significantly.



For and on behalf of BSI, a Notified  
Body for the above Regulation  
(Notified Body Number 0086):

Gary Fenton, Global Product Certification Director

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 1 of 11

...making excellence a habit.™



# Certificate of Constancy of Performance

No. 0086-CPR-96748

**Manufacturing Plant:** **Kentec Electronics Limited**  
Units 25-27 Fawkes Avenue  
Questor  
Dartford  
DA1 1JQ  
United Kingdom

## Product Information

### Sigma XT series

Model Reference	Type
K11031M2	Class A, Single area Fire Extinguishing Control Panel Surface mounting
K11031F2	Class A, Single area Fire Extinguishing Control Panel Flush mounting

Certified for use with Apollo, Fulleon, Hochiki, Nittan, Notifier and MorleyIAS and alarm products and MTL7778ac and MTL5561 intrinsically safe barriers. System Sensor and KAC fire detection.

The Sigma XT is certified when fitted with Swedish Keyswitch.

The Sigma XT is also suitable for use with the following units:

Model Reference	Type
K911000M8	6 lamp status unit surface
K911000F8	6 lamp status unit flush
K911100M8	6 lamp status unit with mode select keyswitch surface
K911100F8	6 lamp status unit with mode select keyswitch flush
K911010M8	6 lamp status unit with manual release surface
K911010F8	6 lamp status unit with manual release flush
K911110M8	6 lamp status unit with mode select keyswitch and manual release surface
K911110F8	6 lamp status unit with mode select keyswitch and manual release flush
W911000W8	IP65 - 6 lamp status unit surface
W911100W8	IP65 - 6 lamp status unit surface with mode select keyswitch surface
W911110W8	IP65 - 6 lamp status unit with mode select keyswitch and manual release surface
K91000M10	Extinguishant hold off switch unit - green button
KB91000M10	Extinguishant hold off switch unit - red button

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 2 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Options with requirements

Certified with the following options with requirements from EN 54-2:1997

Output to fire alarm devices (clause 7.8)  
Delays to outputs (clause 7.11)  
Test condition (clause 10)

Certified with the following options with requirements from EN 12094-1:2003

Delay of extinguishing signal (clause 4.17)  
Signal representing the flow of extinguishing agent (clause 4.18)  
Monitoring of the status of components (clause 4.19)  
Emergency hold device (clause 4.20)  
Control of flooding time (clause 4.21)  
Manual only mode (clause 4.23)  
Triggering signals to equipment within the system (clause 4.24)  
Triggering signals to equipment outside the system (clause 4.26)  
Activation of alarm devices with different signals (clause 4.30)



First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 3 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.

To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## **Sigma XT+ Series**

<b>Model Reference</b>	<b>Type</b>
K21001M2	Class A, Single area extinguishing control unit
K21021M3	Class A, Two zone, single area extinguishing control panel
K21041M3	Class A, Four zone, single area extinguishing control panel
K21042M3	Class A, Four zone, two area extinguishing control panel
K21081M3	Class A, Eight zone, single area extinguishing control panel
K21082M3	Class A, Eight zone, two area extinguishing control panel
K21083M4	Class A, Eight zone, three area extinguishing control panel
K21084M4	Class A, Eight zone, four area extinguishing control panel

Certified for use with Apollo series 30, 60 & 65, Fulleon, Hochiki, Nittan, Notifier and MorleyIAS ECO1000, KAC fire detection and alarm products and MTL7778ac and MTL5561 intrinsically safe barriers.

The Sigma XT+ is certified when fitted with Swedish Keyswitch.

The Sigma XT+ is also suitable for use with the following units:

<b>Model Reference</b>	<b>Type</b>
K911000M8	6 lamp status unit surface
K911000F8	6 lamp status unit flush
K911100M8	6 lamp status unit with mode select keyswitch surface
K911100F8	6 lamp status unit with mode select keyswitch flush
K911010M8	6 lamp status unit with manual release surface
K911010F8	6 lamp status unit with manual release flush
K911110M8	6 lamp status unit with mode select keyswitch and manual release surface
K911110F8	6 lamp status unit with mode select keyswitch and manual release flush
W911000W8	IP65 - 6 lamp status unit surface
W911100W8	IP65 - 6 lamp status unit surface with mode select keyswitch surface
W911110W8	IP65 - 6 lamp status unit with mode select keyswitch and manual release surface
K91000M10	Extinguishant hold off switch unit - green button
KB91000M10	Extinguishant hold off switch unit - red button

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 4 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Options with requirements

Certified with the following options with requirements from EN 54-2:1997

Output to fire alarm devices (clause 7.8)  
Delays to outputs (clause 7.11)  
Test condition (clause 10)

Certified with the following options with requirements from EN 12094-1:2003:

Delay of extinguishing signal (clause 4.17)  
Signal representing the flow of extinguishing agent (clause 4.18)  
Monitoring of the status of components (clause 4.19)  
Emergency hold device (clause 4.20)  
Control of flooding time (clause 4.21)  
Manual only mode (clause 4.23)  
Triggering signals to equipment outside the system (clause 4.26)  
Emergency abort device (clause 4.27)  
Activation of alarm devices with different signals (clause 4.30)



First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 5 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Syncro XT+ K31000 & K32000 Series

Model Reference	Type
A31161M3	Class A, 1 loop, 1 Area Extinguishant Control Panel
A32161M3	Class A, 2 loop, 1 Area Extinguishant Control Panel
A31162M3	Class A, 1 loop, 2 Area Extinguishant Control Panel
A32162M3	Class A, 2 loop, 2 Area Extinguishant Control Panel
A31163M4	Class A, 1 loop, 3 Area Extinguishant Control Panel
A32163M4	Class A, 2 loop, 3 Area Extinguishant Control Panel
A31164M4	Class A, 1 loop, 4 Area Extinguishant Control Panel
A32164M4	Class A, 2 loop, 4 Area Extinguishant Control Panel
H31161M3	Class A, 1 loop, 1 Area Extinguishant Control Panel
H32161M3	Class A, 2 loop, 1 Area Extinguishant Control Panel
H31162M3	Class A, 1 loop, 2 Area Extinguishant Control Panel
H32162M3	Class A, 2 loop, 2 Area Extinguishant Control Panel
H31163M4	Class A, 1 loop, 3 Area Extinguishant Control Panel
H32163M4	Class A, 2 loop, 3 Area Extinguishant Control Panel
H31164M4	Class A, 1 loop, 4 Area Extinguishant Control Panel
H32164M4	Class A, 2 loop, 4 Area Extinguishant Control Panel
V31161M3	Class A, 1 loop, 1 Area Extinguishant Control Panel
V32161M3	Class A, 2 loop, 1 Area Extinguishant Control Panel
V31162M3	Class A, 1 loop, 2 Area Extinguishant Control Panel
V32162M3	Class A, 2 loop, 2 Area Extinguishant Control Panel
V31163M4	Class A, 1 loop, 3 Area Extinguishant Control Panel
V32163M4	Class A, 2 loop, 3 Area Extinguishant Control Panel
V31164M4	Class A, 1 loop, 4 Area Extinguishant Control Panel
V32164M4	Class A, 2 loop, 4 Area Extinguishant Control Panel

Certified for use with Apollo, Hochiki, and Argus Vega fire detection and alarm products

Prefix A = Apollo Protocol, H = Hochiki Protocol & V = Argus Vega Protocol

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 6 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.

To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

The following Sigma Si status units are compatible for use with the K31000 & K32000 models in Table 1:

K911000M8 6 lamp status unit surface

K911000F8 6 lamp status unit flush

K911100M8 6 lamp status unit with mode select keyswitch surface

K911100F8 6 lamp status unit with mode select keyswitch

K911010M8 6 lamp status unit with manual release surface

K911010F8 6 lamp status unit with manual release flush

K911110M8 6 lamp status unit with mode select keyswitch and manual release surface

K911110F8 6 lamp status unit with mode select keyswitch and manual release flush

W911000W8 IP65 - 6 lamp status unit surface

W911100W8 IP65 - 6 lamp status unit surface with mode select keyswitch surface

W911110W8 IP65 - 6 lamp status unit with mode select keyswitch and manual release surface

## Options with requirements

Certified with the following options with requirements from EN 54-2:1997

Output to fire alarm devices (clause 7.8)

Delays to outputs (clause 7.11)

Test condition (clause 10)

Certified with the following options with requirements from EN 12094-1:2003:

Delay of extinguishing signal (clause 4.17) – up to 60 seconds

Signal representing the flow of extinguishing agent (clause 4.18)

Monitoring of the status of components (clause 4.19)

Emergency hold device (clause 4.20)

Control of flooding time (clause 4.21)

Manual only mode (clause 4.23)

Triggering signals to equipment outside the system (clause 4.26)

Emergency abort device (clause 4.27)

Activation of alarm devices with different signals (clause 4.30)

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 7 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.

To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Appendix 1

Harmonised Technical Specification		EN 54-2:1997 + A1
Essential Characteristics	Performance	Clause
<b>Performance Under Fire Conditions</b>		
General requirements	Pass	4
General requirements for indications	Pass	5
The fire alarm condition	Pass	7
<b>Response Delay (response time to fire)</b>		
Reception and processing of fire signals	Pass	7.1
Output of the fire alarm condition	Pass	7.7
Delay to outputs	Pass	7.11
Dependencies on more than one alarm signal	Pass	7.12
<b>Operational Reliability</b>		
General requirements	Pass	4
General requirements for indications	Pass	5
The quiescent condition	Pass	6
The fire alarm condition	Pass	7
Fault warning condition	Pass	8
Disabled condition	Pass	9
Test condition	Pass	10
Standardised input/output interface	Pass	11
Design requirements	Pass	12
Additional design requirements for software controlled control and indicating equipments	Pass	13
Marking	Pass	14
<b>Durability of Operational Reliability</b>		
Cold (operational)	Pass	15.4
Damp heat, steady state (operational)	Pass	15.5
Impact (operational)	Pass	15.6
Vibration, sinusoidal (operational)	Pass	15.7
Electromagnetic Compatibility (EMC), Immunity tests (operational)	Pass	15.8
Supply voltage variations	Pass	15.13
Damp heat, steady state (endurance)	Pass	15.14
Vibration, sinusoidal (endurance)	Pass	15.15

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 8 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.

To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Appendix 1 (Continued)

Harmonised Technical Specification	EN 54-4:1997 + A1 & A2	
Essential Characteristics	Performance	Clause
<b>Performance of Power Supply</b>		
General requirements	Pass	4
Functions	Pass	5
Materials, design and manufacture	Pass	6
<b>Operational Reliability</b>		
General requirements	Pass	4
Functions	Pass	5
Materials, design and manufacture	Pass	6
Documentation	Pass	7
Marking	Pass	8
<b>Durability of Operational Reliability</b>		
Cold (operational)	Pass	9.5
Damp heat, steady state (operational)	Pass	9.6
Impact (operational)	Pass	9.7
Vibration, sinusoidal (operational)	Pass	9.8
Electromagnetic Compatibility (EMC), Immunity tests (operational)	Pass	9.9
Damp heat, steady state (endurance)	Pass	9.14
Vibration, sinusoidal (endurance)	Pass	9.15

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 9 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.

To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).



# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Appendix 1 (Continued)

Harmonised Technical Specification		EN 12094-1:2003
Essential Characteristics	Performance	Clause
<b>Performance Under Fire Conditions</b>		
Signal processing and indication	Pass	4.3
Reception and processing of input triggering signals	Pass	4.4
The fire alarm condition	Pass	4.5
Activation of alarm devices	Pass	4.6
<b>Response Delay (response time to fire)</b>		
Activated condition	Pass	4.8
<b>Operational Reliability</b>		
Environmental Class	Pass	4.2
Signal processing and indication	Pass	4.3
Reception and processing of input triggering signals	Pass	4.4
Transmission of extinguishing signal	Pass	4.5
Activation of alarm devices	Pass	4.6
Indication of the supply with power	Pass	4.7
Activated condition	Pass	4.8
Indication of activated condition	Pass	4.9
Release condition	Pass	4.10
Indication of released condition	Pass	4.11
Resetting of the activated condition and the released condition	Pass	4.12
Fault warning condition	Pass	4.13
Indication of the fault warning condition	Pass	4.14
Disabled condition	Pass	4.15
Indication of disabled condition	Pass	4.16
Mechanical design	Pass	5.2
Manual controls	Pass	5.3
Indication by means of separate light emitting indicators	Pass	5.4.2
Indication by means of alphanumeric displays	Pass	5.4.3
Audible indicators	Pass	5.5
Electrical design of components	Pass	5.6
Circuit design	Pass	5.7

First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 10 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).


BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.

# Certificate of Constancy of Performance

No. 0086-CPR-96748

## Appendix 1 (Continued)

Harmonised Technical Specification		EN 12094-1:2003
Essential Characteristics	Performance	Clause
<b>Operational Reliability</b>		
Additional design requirements for software controlled ECD'S	Pass	6
Marking	Pass	7
Documentation	Pass	8
<b>Durability of Operational Reliability</b>		
Environmental Class	Pass	4.2
Functional tests	Pass	9.2

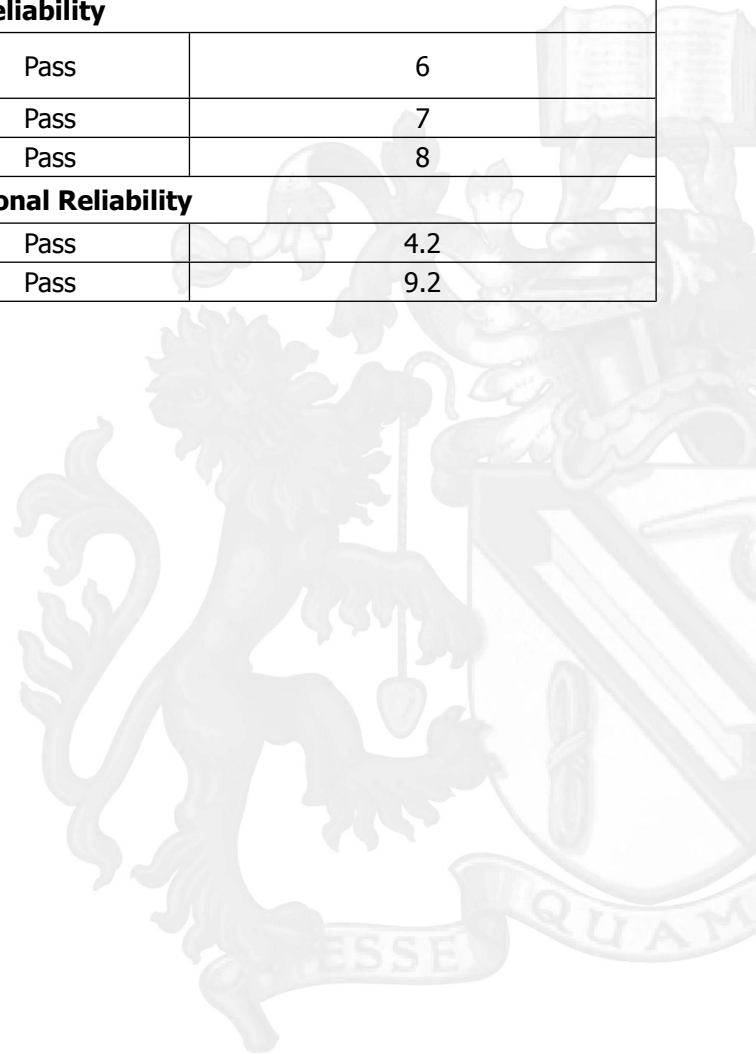


First Issued: 19/10/2005

Latest Issue: 15/12/2015

Page: 11 of 11

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.  
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.  
A member of BSI Group of Companies.



Kentec Electronics Ltd.

# Declaration of Performance

According to Construction Products Regulation EU N° 305/2011



Certificate Reference N° 00004

**Product identification:**

Sigma XT – Extinguishing control panel

**Type:**

K11031 series

**Intended use:**

Component for gas extinguishing systems installed in buildings and field areas as a part of a complete operating system.

**Manufacturer:**

Kentec Electronics Limited  
Units 25-27 Fawkes Avenue  
Questor  
Dartford  
Kent  
DA1 1JQ  
UK

**Authorised representative:**

Not applicable

**System of assessment and verification of constancy of performance.**

System 1

**BSI**

Performed type testing and the initial inspection of the manufacturing plant and of factory production control with continuous surveillance, assessment and approval of the factory production control under system 1 and issued following certificate of conformity:

**0086-CPR-96748**

All requirements including all Essential Characteristics and the corresponding performances for the intended use or uses have been determined as described in the hEN mentioned in the table below.

Essential characteristics	Performance	Harmonized technical specification
Response delay (response time)	Passed	EN12094-1:2003 Art: 4. 5 and 6
Operational reliability	Passed	EN12094-1:2003 Art: 4. 5, 6, 7 and 8
Performance parameters under fire conditions	Passed	EN12094-1:2003 Art: 4.3, 4.4, 4.5 and 4.6
Durability	Passed	EN12094-1:2003 Art: 9

The performance of the product identified above is in conformity with the set of declared performance/s.

This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:




Robert Jefferys

Director

Dartford

17/06/14



Kentec Electronics Ltd.

# Declaration of Performance

According to Construction Products Regulation EU N° 305/2011



Certificate Reference N° 00005

**Product identification:**

Sigma XT+ Extinguishing control panel

**Type:**

K21000 series

**Intended use:**

Component for gas extinguishing systems installed in buildings and field areas as a part of a complete operating system.

**Manufacturer:**

Kentec Electronics Limited  
Units 25-27 Fawkes Avenue  
Questor  
Dartford  
Kent  
DA1 1JQ  
UK

**Authorised representative:**

Not applicable

**System of assessment and verification of constancy of performance.**

System 1

**BSI**

Performed type testing and the initial inspection of the manufacturing plant and of factory production control with continuous surveillance, assessment and approval of the factory production control under system 1 and issued following certificate of conformity:

**0086-CPR-96748**

All requirements including all Essential Characteristics and the corresponding performances for the intended use or uses have been determined as described in the hEN mentioned in the table below.

Essential characteristics	Performance	Harmonized technical specification
Response delay (response time)	Passed	EN12094-1:2003 Art: 4. 5 and 6
Operational reliability	Passed	EN12094-1:2003 Art: 4. 5 , 6, 7 and 8
Performance parameters under fire conditions	Passed	EN12094-1:2003 Art: 4.3, 4.4 , 4.5 and 4.6
Durability	Passed	EN12094-1:2003 Art: 9

The performance of the product identified above is in conformity with the set of declared performance/s.

This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:



Robert Jefferys

Director

Dartford

17/06/14